



**City of Santa Clara
Building Inspection Division**

1500 Warburton Avenue
Santa Clara, CA 95050
Phone: (408) 615-2440
Fax: (408) 241-3823
<http://www.ci.santa-clara.ca.us>

OUTDOOR A/C SYSTEM


October 15, 2004

OUTDOOR A/C SYSTEM

A plot plan must be submitted showing property lines, house and other buildings on lot, location of condensing unit, dimensions of unit and distances from property lines.

Electric Requirements:

1. Disconnect to be readily accessible and within sight of a.c.
2. Use rating on AC nameplate min. circuit, fuse or Hacar size – max fuse or Hacar.

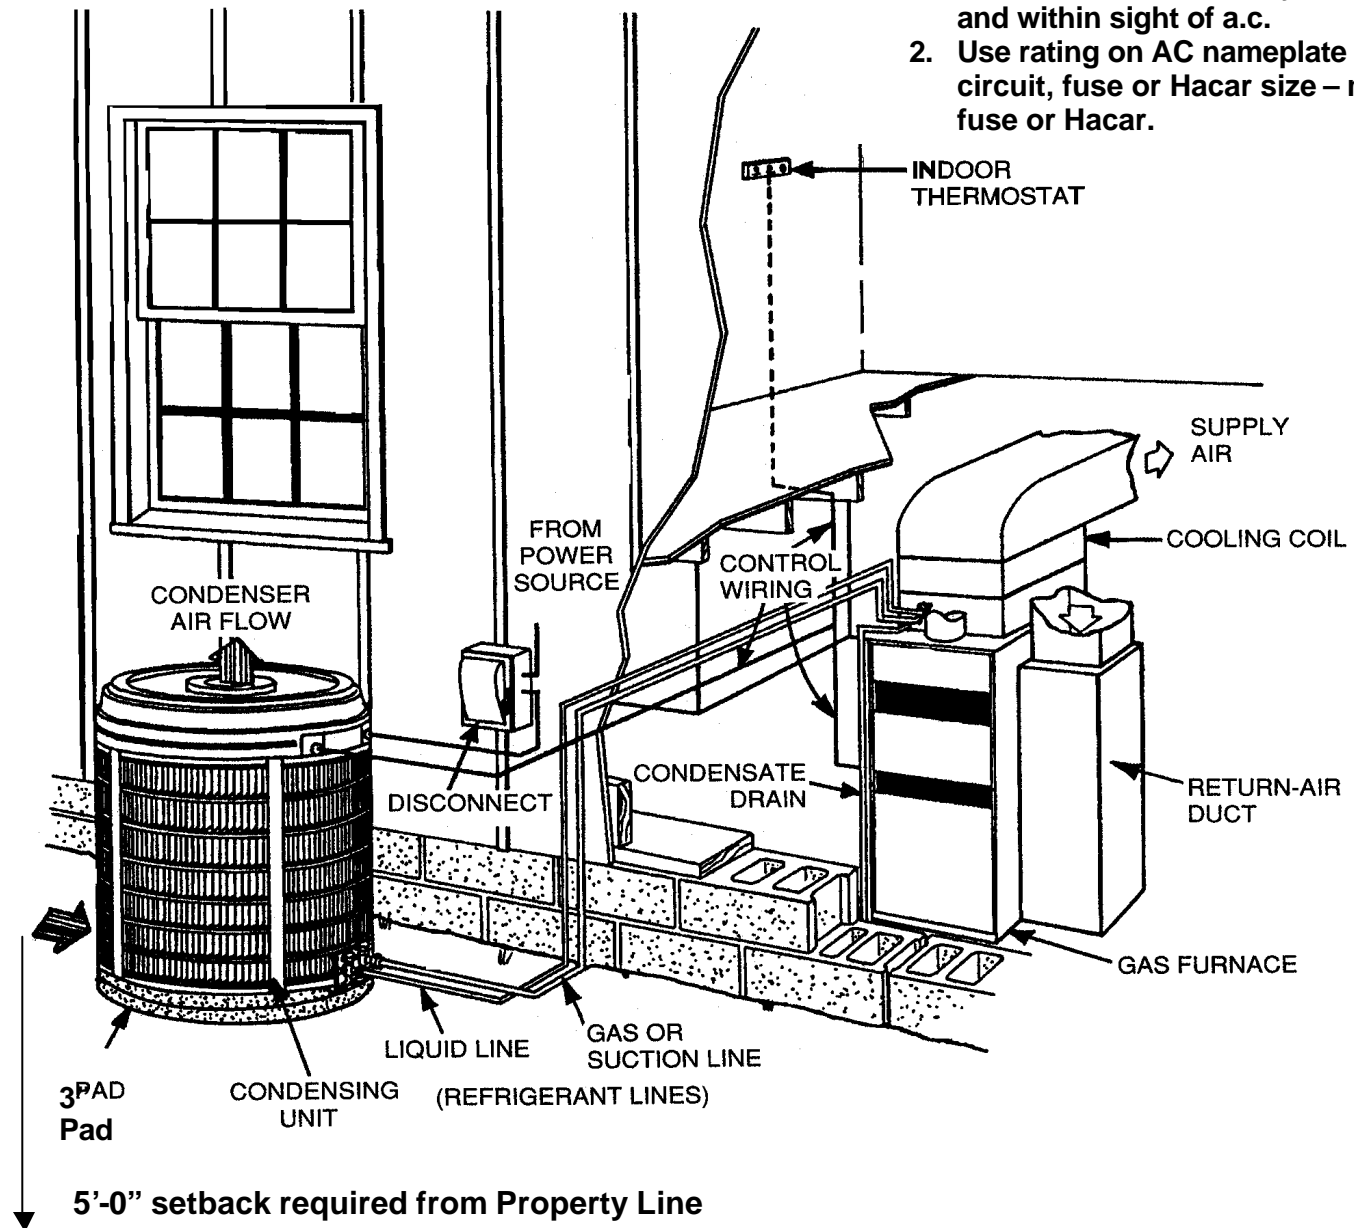

TYPICAL "SPLIT SYSTEM" AIR-CONDITIONING SYSTEM: UPRIGHT GAS FURNACE WITH INTEGRAL COOLING COIL; CONDENSING UNIT ON EXTERIOR OF BUILDING